



**ADDENDUM NO. 01**  
July 26, 2024

To Drawings and Specifications approved under DSA stamp dated June 20, 2024.

**ENEC Site Demolition**

5921 E Levee Road  
Sacramento, CA 95835

**Twin Rivers Unified School District**

Prepared by: PBK  
1110 Iron Point Road, Suite 200  
Folsom, California 95630


PBK Project No.: 240007  
DSA App No.: 02-122236

- A. Receipt of this Addendum shall be acknowledged on the Bid Form.
- B. This Addendum forms part of the Contract documents for the above referenced project and shall be incorporated integrally therewith.
- C. Each bidder shall make necessary adjustments and submit this proposal with full knowledge of all modifications, clarifications, and supplemental data included therein. Where provisions of the following supplemental data differ from those of the original Contract Documents, this Addendum shall govern.

**ADDITIONAL DOCUMENTS:**

- Item 01: Sacramento Metropolitan AQMD Asbestos Renovation/Demolition Notification Form (2 pages total)
- Item 02: Asbestos Demolition Building Inspection/Survey and Asbestos Sample Location Map (13 pages total)

**End of Addendum No. 01**

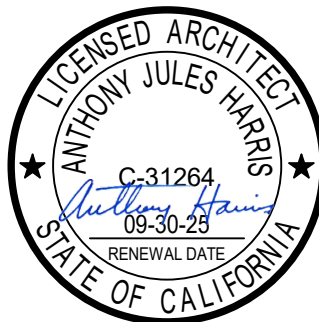

# Asbestos Renovation/Demolition Notification Form

<b>1</b>	Building Department Permit Application # (if known) : _____	<input type="checkbox"/> Renovation (Do not complete Section 5) <input checked="" type="checkbox"/> Demolition (Complete all sections) <input type="checkbox"/> Ordered Demo - Attach ordered demo letter <input type="checkbox"/> Emergency Demo - SMAQMD Emergency #: _____
----------	--	--

<b>2</b>	Contractor	Owner
	Address	Address
	City, State / Zip	City, State / Zip
	Email	Email
	Telephone	Telephone

<b>3</b>	Structure Name <b>East Natomas Education Complex</b>	Renovation Area	# of Floors
	Project Address <b>5921 East Levee Road</b>	City / Zip <b>Sacramento, CA 95835</b>	Year Built

<b>4</b>	Preference for return of form	<input type="checkbox"/> E-mail :	<input type="checkbox"/> Other :
----------	-------------------------------	-----------------------------------	----------------------------------


**DEMOLITION ONLY** – Start date must be at least 10 working days from the day of your postmark or hand delivery of this form.

<b>5</b>	Start Date _____/_____/_____	Revision # 1 2 3 4 5 6 7 8 9 (circle)
	Completion Date _____/_____/_____	New Start Date _____/_____/_____
		New Completion Date _____/_____/_____
Method of Demo (Check Applicable): <input type="checkbox"/> Manual/Hand Tools <input type="checkbox"/> Mechanical/Heavy Equipment <input type="checkbox"/> Other		
Procedure to be followed if RACM is found or Category II material becomes friable:		

*I have read and understand the directions. The information on this form is true and accurate.  
 I certify that the asbestos survey conducted represents the facility as built.*

<b>6</b>	Applicant Name (Print)	<input type="checkbox"/> Owner <input type="checkbox"/> Rep / Agent <input type="checkbox"/> Contractor	Permit may be issued on:
	Phone Number		
	Applicant's Signature	Date	

**Have DOSH Consultant complete and sign below OR attach completed Asbestos Survey Form and Consultant's report.**

<b>CONSULTANT USE ONLY</b>	Company Name <b>National Analytical Labs, Inc.</b>	Telephone <b>916-361-0555</b>		
	Surveyor Name <b>Michael J. Lee</b>	DOSH # <b>06-4047</b>	Survey Date <b>04/02/24</b>	
	Analytical Method <b>Polarized Light Microscopy (PLM)</b>	Pt Count Materials <10%? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> Declined by Client		
	Amount of RACM	Square Feet <b>0</b>	Linear Feet <b>0</b>	Cubic Feet <b>0</b>
	Amount of Category I	<b>0</b>	Amount of Category II	<b>0</b>
	Project Address <b>5921 East Levee Road</b>	City <b>Sacramento</b>	Zip <b>95835</b>	
	Suspect Materials Present? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Consultant's Signature 		

SMAQMD USE ONLY

Date Received / Date Postmarked \_\_\_\_\_ Date Approved & Returned \_\_\_\_\_

Project # \_\_\_\_\_ Check # \_\_\_\_\_ Receipt # \_\_\_\_\_ Amount Paid \_\_\_\_\_ Staff \_\_\_\_\_

**Failure to comply with asbestos regulations can result in civil/criminal penalties as specified in CH&SC §42400-42402**

**PURPOSE:**

Your project has been deemed jurisdictional by the US EPA and the Sacramento Metropolitan Air Quality Management District (SMAQMD). **You will not receive a permit from the building department until you complete this form. SMAQMD will approve\* and return this form to you to bring to the building department.** In order to prevent the release of asbestos into the environment, you must properly identify and abate\*\* all regulated asbestos materials prior to the start of your renovation or demolition project. You must first retain a certified Cal/OSHA asbestos consultant to conduct your asbestos survey and identify all regulated asbestos containing building materials. To properly abate the identified regulated materials, you must hire a licensed asbestos abatement contractor. You may find local asbestos consultants and contractors in the yellow pages or online under "Asbestos or Environmental Consulting" and "Asbestos or Environmental Contractors".

**DIRECTIONS:**

The numbers below correspond to the item numbers on the front of this form.

1. Input the Building Department's Permit Application Number or Case Number (if known).  
Indicate the type of project using the following definitions:
  - **DEMOLITION:** The wrecking, taking out, disturbing, or burning of any load-supporting/structural member of any facility. Common examples include impact to load bearing wall(s), roof rafter(s), razing/moving the entire structure.
  - **RENOVATION:** Any operation other than a demolition. Common examples would be tenant improvements and partial or complete remodels where load bearing walls are not being removed.
  - **ORDERED DEMOLITION:** The demo of a facility pursuant to an order of an authorized representative of a state or local government agency, issued because the structure is structurally unsound or in danger of imminent collapse.
  - **EMERGENCY DEMOLITION:** A renovation that results from a "sudden, unexpected event that applies to the abatement of the immediate hazard and, that if not immediately attended to: presents a safety or public health hazard, is necessary to protect equipment from damage, or is necessary to avoid imposing an unreasonable financial burden." Ultimate approval of the use of this provision is left to the discretion of the Air Pollution Control Officer. Operations necessitated by non-routine failures of equipment are included.
2. Complete Contractor and Owner information. A contractor refers to the party doing the renovation/demolition work.
3. Structure Name: Any commercial/institution name for the structure.  
Project Address: Provide structure address.  
Renovation Area: Include name of area to be renovated (ex. "bathroom", "first floor", "roof", etc.) and total size in square feet.  
Number of Floors: Count basement as a floor.  
Year Built: Age of the oldest portion of the structure that will be impacted by the project.
4. Select method of receiving form. **To expedite the process use [asbestos@airquality.org](mailto:asbestos@airquality.org) for sending items to SMAQMD.** If fees are due, payments can be made with GOV PAY @ <https://www.govpaynow.com/gps/user/plc/7526>

**IF DEMOLITION, ORDERED DEMOLITION, OR EMERGENCY DEMOLITION PROJECT, COMPLETE SECTIONS 5 & 6. FOR RENOVATION PROJECTS, SKIP TO SECTION 6**

5. Project Dates: These are the actual dates the demolition will start and end. Although asbestos may not be detected or the survey indicates RACM less than 160 square or 260 linear feet, the start date must reflect at least 10 business days from the date of postmark/delivery to SMAQMD. In those instances, submit a \$435 plan fee along with this form and your asbestos survey. SMAQMD will verify that your information is complete and validate the form.  
Revisions: You are required to notify SMAQMD of any information that may change after submittal of this form. Use the revision box for date changes. Date changes must be notified on or prior to the last notified date. Revisions may be faxed to (916) 874-4899 or emailed to [Asbestos@airquality.org](mailto:Asbestos@airquality.org). Circle the appropriate revision number each time you revise.  
Indicate method of demolition.  
Indicate procedures to be followed if RACM is found or Category II material becomes friable.  
Cancellation Policy: Upon cancellation of a demolition project, a minimum administrative fee will be deducted from the original fees submitted. If a site inspection was conducted prior to the cancellation, there will be no refund of fees submitted.
6. Print and sign your name and indicate whether you are the owner, contractor, or representative / agent.

**FOR CONSULTANT USE ONLY**

You have the option of either having this section completed by your consultant OR submitting your full asbestos survey with an asbestos survey form completed and signed by your consultant. The RACM amounts listed are the amounts to be removed during this project. Please indicate if there were any suspect materials present to sample. Indicate whether point counting was conducted for materials with detectable asbestos in concentration <10%.

\***Approval** will be a SMAQMD date stamp, which will specify that you have met SMAQMD survey requirements and indicate to the building department that you may receive your renovation or demolition permit on or after that date, **provided you have met all other building department requirements.** If the survey or this form is incomplete or inaccurate and cannot be approved, this form will be rejected and you will be contacted with an explanation of the problem. You will have to correct and resubmit forms to SMAQMD for approval. SMAQMD will make your form available within 2 working days of receipt.

\*\***Abatement** is only required for renovations if the RACM is expected to be impacted during the project or if Category II materials are likely to become crumbled, pulverized, or reduced to powder during the course of the project.

**ASSISTANCE AVAILABLE:** SMAQMD business hours: M-F, 8-5pm. (916) 874-4800. View our website [www.airquality.org](http://www.airquality.org) for information on asbestos as well as this and other forms. Asbestos staff are available for personal consultations, M-F, 8:00 AM to 10:00 AM.

**Asbestos Demolition Building  
Inspection/Survey**

**East Natomas Education Complex**

**5921 East Levee Road  
Sacramento, CA 95835**

**Presented to:**

*Ronnie Hill  
Greystone West Company  
c/o*

*Twin Rivers Unified School District  
3222 Winona Way  
North Highlands, CA 95660*

**Inspection Date:**

*April 02, 2024*

**Reviewed and submitted by:**

*Michael J. Lee  
Certified Asbestos Consultant  
Registered Environmental Property Assessor*

**Conducted by:**

*Joseph Wilkins  
Certified Site Surveillance Technician*

**National Analytical Laboratories, Inc.**

*2201 Francisco Dr., Ste. 140-261  
El Dorado Hills, CA 95742  
Office: (916) 361-0555 | Fax: (916) 361-0540  
E-Mail: NAL1@NAL1.com | Web Page: www.NAL1.com*





April 03, 2024

Ronnie Hill  
Greystone West Company c/o  
Twin Rivers Unified School District  
3222 Winona Way  
North Highlands, CA 95660

RE: **Asbestos Demolition Building Inspections/Survey  
East Natomas Education Complex  
5921 East Levee Road  
Sacramento, CA 95835**

Dear Mr. Hill,

The following report is regarding the building inspection conducted at the above-referenced location. **Of the forty-one (41) suspected asbestos-containing samples collected, none (0) were found to contain asbestos.** Joseph Wilkins, a Certified Site Surveillance Technician, working with National Analytical Laboratories, Inc. (N.A.L.), conducted the inspection on April 02, 2024.

#### ***SUMMARY OF FINDINGS -***

**The asbestos building inspection and analytical results indicate that no asbestos is present in the materials tested.**

The Technician noted that there was no access to Building D and Building E's Roof, and all Roofing was the same as that of Building F. There was no material to test inside Portable 3.

#### ***ASBESTOS INSPECTION -***

The inspection was completed according to the EPA's Asbestos Containing Building Materials (ACBM) In-Schools Rule; 40 CFR 763.85 (Inspection and Re-Inspection). Currently, the EPA regulations classify ACBM as materials containing more than 1 percent (1%) of asbestos. Cal-OSHA currently regulates asbestos to 1/10th of 1% (0.1%) and requires a certified asbestos worker to conduct this work.

Upon completing the visual inspection, the suspect asbestos bulk sample materials were collected under the EPA and Cal-OSHA protocol. They were placed into new plastic bags, sealed, and identified with unique identification numbers. The bulk samples were transported to the laboratory under a chain of custody protocol for analysis. MicroTest Laboratories, Inc., located in Rancho Cordova, California, analyzed the bulk suspect asbestos-containing samples, utilizing Polarized Light Microscopy (PLM) EPA Method 600/R-93/116. National Voluntary Laboratory Accreditation Program (NVLAP), certification number 200999-0, certifies MicroTest Laboratories, Inc.

**Breathe easy...**

2201 Francisco Dr. Ste. 140-261 El Dorado Hills, CA 95762  
916.361.0555 | Email: Service@nal1.com

Although minor destructive sampling was conducted during the site visit, if demolition work reveals any unforeseen suspect materials or any future renovation/demolition work is to be conducted in other areas at the site, the contractor shall cease all work and contact the building owner for further testing.

The like materials that were not tested will be treated as homogeneous to the tested materials and considered non-asbestos.

The following samples were **non-asbestos-containing materials**:

Sample ID#	Material	Location	Results
5921-1	Concrete	Bldg. A Floor, Center Area	None Detected
5921-2	Concrete	Bldg. C Floor, Center Area	None Detected
5921-3	Fireproofing	Bldg. D, W. Area	None Detected
5921-4	Fireproofing	Bldg. D, Center Area	None Detected
5921-5	Fireproofing	Bldg. D, E. Area	None Detected
5921-6	Sheetrock-Joint Compound	Bldg. D, E. Area	None Detected
5921-7	Mastic	Bldg. D, W. Area, Wall Joint	None Detected
5921-8	Concrete	Bldg. D, W. Area, Wall	None Detected
5921-9	Concrete	Bldg. D Floor, Center Area	None Detected
5921-10	Fireproofing	Bldg. E, W. Area	None Detected
5921-11	Fireproofing	Bldg. E, Center Area	None Detected
5921-12	Fireproofing	Bldg. E, E. Area	None Detected
5921-13	Sheetrock-Joint Compound	Bldg. E, E. Area	None Detected
5921-14	Mastic	Bldg. E, E. Area, Wall Joint	None Detected
5921-15	Concrete	Bldg. E, W. Wall	None Detected
5921-16	Concrete	Bldg. E Floor, Center Area	None Detected
5921-17	Sheetrock-Joint Compound	Bldg. F, Electrical Room	None Detected
5921-18	Roofing Core	Bldg. F, Roof, N. Area	None Detected
5921-19	Roofing Core	Bldg. F, Roof, S. Area	None Detected
5921-20	Mastic	Bldg. F, N. Area, Wall Joint	None Detected
5921-21	Concrete	Bldg. F, N. Wall	None Detected
5921-22	Concrete	Bldg. F Floor, Center Area	None Detected
5921-23	Concrete	Bldg. G Floor, Center Area	None Detected
5921-24	Concrete	Bldg. N Floor, Center Area	None Detected
5921-25	Concrete	Bldg. P Floor, Center Area	None Detected
5921-26	Stucco	Exterior, Center Pillar, N. Area	None Detected
5921-27	Stucco	Exterior, Center Pillar, Center Area	None Detected
5921-28	Stucco	Exterior, Center Pillar, S. Area	None Detected
5921-29	Stucco	Exterior, P1, N. Wall	None Detected
5921-30	Stucco	Exterior, P1, S. Wall	None Detected
5921-31	Stucco	Exterior, P1, E. Wall	None Detected
5921-32	Sheetrock	P1, N. Wall	None Detected
5921-33	Concrete	P1 Floor, Center Area	None Detected
5921-34A	White Flooring	P3 Floor	None Detected
5921-34B	Yellow Mastic	P3 Floor	None Detected
5921-35	Cove Base Mastic	P3, Base	None Detected
5921-36	Acoustic Ceiling Tile	P4 Ceiling	None Detected
5921-37A	White Flooring	P4 Floor	None Detected
5921-37B	Yellow Mastic	P4 Floor	None Detected
5921-38A	Black Roofing Core	P4 Roof	None Detected
5921-38B	Silver Material	P4 Roof	None Detected



**ASBESTOS CONCLUSION -**

No asbestos was detected in the above-listed samples/materials. Therefore, the contractor, their employees, and the subcontractors can complete their work in the specific areas tested without any health or safety concerns regarding the exposure to airborne asbestos fibers.

**ASSUMPTIONS AND LIMITATIONS -**

The results, findings, conclusions, and recommendations expressed in this report are based only on conditions noted during N.A.L.'s inspection of the specific areas listed herein.

The selection of sample locations and sampling frequency was based on observations and the assumption that like materials in the same area are homogeneous in content. This report is not to be utilized as a bidding or project specification document since it does not have all the components required to serve as an Asbestos Abatement Project Design document or an Asbestos Abatement Work plan.

Our professional services have been performed, our findings obtained, and our conclusions and recommendations prepared following established principles and practices in environmental testing and consulting. This report does not warrant undiscovered hazards and locations not investigated.


This report includes the laboratory analytical results, chain custody forms, and asbestos sample location map. If you have any questions regarding this report or need further assistance, please get in touch with our office.

Reviewed and submitted by:



Michael J. Lee  
Certified Asbestos Consultant  
DOSH# 06-4047 Exp. 08/16/24  
Registered Environmental Property Assessor  
REPA# 716352750

Conducted by:



Joseph Wikins  
Certified Site Surveillance Technician  
DOSH# 17-5890







**MicroTest Laboratories Inc. NVLAP Code: 200999-0**  
 3110 Gold Canal Dr. Ste. A. Rancho Cordova, CA 95670  
 PH 916.567.9808 | FX 916.404.0302  
 www.microtestlabsinc.com | service@microtestlabsinc.com

**Project ID**  
**MT012444064**

**CLIENT INFORMATION**

**Company** National Analytical Laboratories, Inc.  
**Name** Paula Lee  
**Address** 2201 Francisco Drive, Ste. 140-261  
 El Dorado Hills, CA 95762  
**Phone** (916) 361 - 0555  
**Email** N.A.L. Distribution List

**SAMPLE**

**Date** Tuesday, April 02, 2024  
**Time** 9:00 AM

**JOB SITE INFORMATION**

**Sampler** Joseph Wilkins  
**Project** East Natomas Education Complex Property  
**Address** 5921 East Levee Road  
 Sacramento, California 95835

**MicroTest**

**Laboratories**

Analytical Data

**POLARIZED LIGHT MICROSCOPY (PLM)**

**EPA METHOD 600 / R-93 / 116 & EPA – 40 CFR Appendix E to Subpart E of Part 763**

Sample ID	Accession Number	Client Description	Laboratory Description	Non Fibrous / Fibrous Materials	Asbestiform Minerals %
5921-1	44064-1	Bldg. A Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-2	44064-2	Bldg. C Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-3	44064-3	Bldg. D, W. Area	White Fireproofing Fibrous Heterogenous	45% Cellulose 55% Binder	None Detected
5921-4	44064-4	Bldg. D, Center Area	White Fireproofing Fibrous Heterogenous	45% Cellulose 55% Binder	None Detected
5921-5	44064-5	Bldg. D, E. Area	White Fireproofing Fibrous Heterogenous	45% Cellulose 55% Binder	None Detected

**Date Received:** Tuesday, April 02, 2024  
**Date Analyzed:** Tuesday, April 02, 2024  
**Date Reported:** Tuesday, April 02, 2024

**Analyst:** Andres De Ferrari  
 Rosey Nagra

**Authorized Signatory:**

Kelly Favero - Lab Manager

This analytical data sheet constitutes a final report. Due to the limitation of Polarized Light Microscopy (PLM), some samples classified as containing no asbestos in materials, NoneDetected (ND), such as floor tiles or like materials, warrant a recommendation for further analysis by Transmission Electron Microscopy (TEM). Results apply only to the sample as received. This report must not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. All Samples will be held for not less than 30 days, upon which they will then be disposed of. This report shall not be reproduced except in full without written authorization from MicroTest Laboratories, Inc. Soil and rock matrices are considered problematic matrices and MicroTest recommends sample homogenization prior to PLM analysis. Thermal decomposition of asbestos fibers can yield non-asbestiform mineral properties. The reporting limit for calibrated visual area estimation quantitation procedures is 1%. The reporting limit for 400/1000 point count quantitation procedures is 0.25% or 0.1% respectively. The sample is considered acceptable unless otherwise noted. Layers are analyzed separately except when manufactured with multiple layers (i.e. Linoleum, Drywall, etc.) or requested contrarily by the client.





**MicroTest Laboratories Inc. NVLAP Code: 200999-0**  
 3110 Gold Canal Dr. Ste. A. Rancho Cordova, CA 95670  
 PH 916.567.9808 | FX 916.404.0302  
 www.microtestlabsinc.com | service@microtestlabsinc.com

**Project ID**  
**MT012444064**

5921-6	44064-6	Bldg. D, E. Area	White Sheetrock-Joint Compound Fibrous Heterogenous	10% Cellulose 90% Binder	None Detected
5921-7	44064-7	Bldg. D, W. Area, Wall Joint	White Mastic Non-Fibrous Homogenous	100% Binder	None Detected
5921-8	44064-8	Bldg. D, W. Area, Wall	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-9	44064-9	Bldg. D Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-10	44064-10	Bldg. E, W. Area	White Fireproofing Fibrous Heterogenous	45% Cellulose 55% Binder	None Detected
5921-11	44064-11	Bldg. E, Center Area	White Fireproofing Fibrous Heterogenous	45% Cellulose 55% Binder	None Detected
5921-12	44064-12	Bldg. E, E. Area	White Fireproofing Fibrous Heterogenous	45% Cellulose 55% Binder	None Detected
5921-13	44064-13	Bldg. E, E. Area	White Sheetrock-Joint Compound Fibrous Heterogenous	10% Cellulose 90% Binder	None Detected
5921-14	44064-14	Bldg. E, E. Area, Wall Joint	White Mastic Non-Fibrous Homogenous	100% Binder	None Detected
5921-15	44064-15	Bldg. E, W. Wall	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected

**Date Received:** Tuesday, April 02, 2024  
**Date Analyzed:** Tuesday, April 02, 2024  
**Date Reported:** Tuesday, April 02, 2024

**Analyst:** Andres De Ferrari  
Rosey Nagra

**Authorized Signatory:**

Kelly Favero - Lab Manager

This analytical data sheet constitutes a final report. Due to the limitation of Polarized Light Microscopy (PLM), some samples classified as containing no asbestos in materials, NoneDetected (ND), such as floor tiles or like materials, warrant a recommendation for further analysis by Transmission Electron Microscopy (TEM). Results apply only to the sample as received. This report must not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. All Samples will be held for not less than 30 days, upon which they will then be disposed of. This report shall not be reproduced except in full without written authorization from MicroTest Laboratories, Inc. Soil and rock matrices are considered problematic matrices and MicroTest recommends sample homogenization prior to PLM analysis. Thermal decomposition of asbestos fibers can yield non-asbestiform mineral properties. The reporting limit for calibrated visual area estimation quantitation procedures is 1%. The reporting limit for 400/1000 point count quantitation procedures is 0.25% or 0.1% respectively. The sample is considered acceptable unless otherwise noted. Layers are analyzed separately except when manufactured with multiple layers (i.e. Linoleum, Drywall, etc.) or requested contrarily by the client.



**MicroTest Laboratories Inc. NVLAP Code: 200999-0**  
 3110 Gold Canal Dr. Ste. A. Rancho Cordova, CA 95670  
 PH 916.567.9808 | FX 916.404.0302  
 www.microtestlabsinc.com | service@microtestlabsinc.com

**Project ID**  
**MT012444064**

5921-16	44064-16	Bldg. E Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-17	44064-17	Bldg. F, Electrical Room	White Sheetrock-Joint Compound Fibrous Heterogenous	10% Cellulose 90% Binder	None Detected
5921-18	44064-18	Bldg. F, Roof, N. Area	White Roofing Core Fibrous Heterogenous	10% Synthetic 90% Binder	None Detected
5921-19	44064-19	Bldg. F, Roof, S. Area	White Roofing Core Fibrous Heterogenous	10% Synthetic 90% Binder	None Detected
5921-20	44064-20	Bldg. F, N. Area, Wall Joint	White Mastic Non-Fibrous Homogenous	100% Binder	None Detected
5921-21	44064-21	Bldg. F, N. Wall	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-22	44064-22	Bldg. F Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-23	44064-23	Bldg. G Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-24	44064-24	Bldg. N Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-25	44064-25	Bldg. P Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected

**Date Received:** Tuesday, April 02, 2024  
**Date Analyzed:** Tuesday, April 02, 2024  
**Date Reported:** Tuesday, April 02, 2024

**Analyst:** Andres De Ferrari  
Rosey Nagra

**Authorized Signatory:**

Kelly Favero - Lab Manager

This analytical data sheet constitutes a final report. Due to the limitation of Polarized Light Microscopy (PLM), some samples classified as containing no asbestos in materials, NoneDetected (ND), such as floor tiles or like materials, warrant a recommendation for further analysis by Transmission Electron Microscopy (TEM). Results apply only to the sample as received. This report must not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. All Samples will be held for not less than 30 days, upon which they will then be disposed of. This report shall not be reproduced except in full without written authorization from MicroTest Laboratories, Inc. Soil and rock matrices are considered problematic matrices and MicroTest recommends sample homogenization prior to PLM analysis. Thermal decomposition of asbestos fibers can yield non-asbestiform mineral properties. The reporting limit for calibrated visual area estimation quantitation procedures is 1%. The reporting limit for 400/1000 point count quantitation procedures is 0.25% or 0.1% respectively. The sample is considered acceptable unless otherwise noted. Layers are analyzed separately except when manufactured with multiple layers (i.e. Linoleum, Drywall, etc.) or requested contrarily by the client.



**MicroTest Laboratories Inc. NVLAP Code: 200999-0**  
 3110 Gold Canal Dr. Ste. A. Rancho Cordova, CA 95670  
 PH 916.567.9808 | FX 916.404.0302  
 www.microtestlabsinc.com | service@microtestlabsinc.com

**Project ID**  
**MT012444064**

5921-26	44064-26	Exterior, Center Pillar, N. Area	Gray Stucco Non-Fibrous Heterogenous	100% Binder	None Detected
5921-27	44064-27	Exterior, Center Pillar, Center Area	Gray Stucco Non-Fibrous Heterogenous	100% Binder	None Detected
5921-28	44064-28	Exterior, Center Pillar, S. Area	Gray Stucco Non-Fibrous Heterogenous	100% Binder	None Detected
5921-29	44064-29	Exterior, P1, N. Wall	Gray Stucco Non-Fibrous Heterogenous	100% Binder	None Detected
5921-30	44064-30	Exterior, P1, S. Wall	Gray Stucco Non-Fibrous Heterogenous	100% Binder	None Detected
5921-31	44064-31	Exterior, P1, E. Wall	Gray Stucco Non-Fibrous Heterogenous	100% Binder	None Detected
5921-32	44064-32	P1, N. Wall	White Sheetrock Fibrous Heterogenous	10% Cellulose 90% Binder	None Detected
5921-33	44064-33	P1 Floor, Center Area	Gray Concrete Non-Fibrous Heterogenous	100% Binder	None Detected
5921-34A	44064-34A	P3 Floor	White Flooring Non-Fibrous Heterogenous	100% Binder	None Detected
5921-34B	44064-34B	P3 Floor	Yellow Mastic Non-Fibrous Homogenous	100% Binder	None Detected

**Date Received:** Tuesday, April 02, 2024  
**Date Analyzed:** Tuesday, April 02, 2024  
**Date Reported:** Tuesday, April 02, 2024

**Analyst:** Andres De Ferrari  
Rosey Nagra

**Authorized Signatory:**

Kelly Favero - Lab Manager

This analytical data sheet constitutes a final report. Due to the limitation of Polarized Light Microscopy (PLM), some samples classified as containing no asbestos in materials, NoneDetected (ND), such as floor tiles or like materials, warrant a recommendation for further analysis by Transmission Electron Microscopy (TEM). Results apply only to the sample as received. This report must not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. All Samples will be held for not less than 30 days, upon which they will then be disposed of. This report shall not be reproduced except in full without written authorization from MicroTest Laboratories, Inc. Soil and rock matrices are considered problematic matrices and MicroTest recommends sample homogenization prior to PLM analysis. Thermal decomposition of asbestos fibers can yield non-asbestiform mineral properties. The reporting limit for calibrated visual area estimation quantitation procedures is 1%. The reporting limit for 400/1000 point count quantitation procedures is 0.25% or 0.1% respectively. The sample is considered acceptable unless otherwise noted. Layers are analyzed separately except when manufactured with multiple layers (i.e. Linoleum, Drywall, etc.) or requested contrarily by the client.



**MicroTest Laboratories Inc. NVLAP Code: 200999-0**  
 3110 Gold Canal Dr. Ste. A. Rancho Cordova, CA 95670  
 PH 916.567.9808 | FX 916.404.0302  
 www.microtestlabsinc.com | service@microtestlabsinc.com

**Project ID**  
**MT012444064**

5921-35	44064-35	P3, Base	Beige Mastic Non-Fibrous Homogenous	100% Binder	None Detected
5921-36	44064-36	P4 Ceiling	White Ceiling Tile Fibrous Heterogenous	90% Cellulose 10% Binder	None Detected
5921-37A	44064-37A	P4 Floor	White Flooring Non-Fibrous Heterogenous	100% Binder	None Detected
5921-37B	44064-37B	P4 Floor	Yellow Mastic Non-Fibrous Homogenous	100% Binder	None Detected
5921-38A	44064-38A	P4 Roof	Black Roofing Core Fibrous Heterogenous	10% Synthetic 90% Binder	None Detected
5921-38B	44064-38B	P4 Roof	Silver Material Non-Fibrous Homogenous	100% Binder	None Detected

**Date Received:** Tuesday, April 02, 2024  
**Date Analyzed:** Tuesday, April 02, 2024  
**Date Reported:** Tuesday, April 02, 2024

**Analyst:** Andres De Ferrari  
Rosey Nagra

**Authorized Signatory:**

Kelly Favero - Lab Manager

This analytical data sheet constitutes a final report. Due to the limitation of Polarized Light Microscopy (PLM), some samples classified as containing no asbestos in materials, NoneDetected (ND), such as floor tiles or like materials, warrant a recommendation for further analysis by Transmission Electron Microscopy (TEM). Results apply only to the sample as received. This report must not be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. All Samples will be held for not less than 30 days, upon which they will then be disposed of. This report shall not be reproduced except in full without written authorization from MicroTest Laboratories, Inc. Soil and rock matrices are considered problematic matrices and MicroTest recommends sample homogenization prior to PLM analysis. Thermal decomposition of asbestos fibers can yield non-asbestiform mineral properties. The reporting limit for calibrated visual area estimation quantitation procedures is 1%. The reporting limit for 400/1000 point count quantitation procedures is 0.25% or 0.1% respectively. The sample is considered acceptable unless otherwise noted. Layers are analyzed separately except when manufactured with multiple layers (i.e. Linoleum, Drywall, etc.) or requested contrarily by the client.



**Project ID**  
MT012444064

**CLIENT INFORMATION**

**Company** Twin Rivers School District  
c/o Greystone West  
Company  
**Name** Ronnie Hill  
**Address** 3222 Winona Way  
North Highlands CA, 95660  
**Phone** (707) 322 - 3270  
**Email** denise@greystonewest.com

**Sample**  
**Date** Tuesday, April 02, 2024  
**Time** 09:00 AM

**Chain-Of-Custody**

**JOB SITE INFORMATION**

**Site** East Natomas Education  
Complex Property  
**Address** 5921 East Levee Road  
Sacramento, California  
95835  
**Unit**  
**Claim#**  
**Job #** 76094  
**Chain #** 1

**Analysis:** PLM | TTFP - 400 PT.CT.  
**Turn Around Time:** Same Day

Sample Number:	Location	Description
5921-1	Bldg. A Floor, Center Area	Concrete
5921-2	Bldg. C Floor, Center Area	Concrete
5921-3	Bldg. D, W. Area	Fireproofing
5921-4	Bldg. D, Center Area	Fireproofing
5921-5	Bldg. D, E. Area	Fireproofing
5921-6	Bldg. D, E. Area	Sheetrock-Joint Compound
5921-7	Bldg. D, W. Area, Wall Joint	Mastic
5921-8	Bldg. D, W. Area, Wall	Concrete
5921-9	Bldg. D Floor, Center Area	Concrete
5921-10	Bldg. E, W. Area	Fireproofing
5921-11	Bldg. E, Center Area	Fireproofing

Relinquished by (Client)	Date/Time

Received by (Tech)	Date/Time

Relinquished by (Tech)	Date/Time
<i>Am Wilks</i>	04/02/2024 09:00 AM

Received by (Lab)	Date/Time
<i>mg</i>	04/02/2024 1:40 PM

Sampler: Joseph Wilkins

Total Number of Samples 38



**Project ID**  
 MT012444064

Sample Number:	Location	Description
5921-12	Bldg. E, E. Area	Fireproofing
5921-13	Bldg. E, E. Area	Sheetrock-Joint Compound
5921-14	Bldg. E, E. Area, Wall Joint	Mastic
5921-15	Bldg. E, W. Wall	Concrete
5921-16	Bldg. E Floor, Center Area	Concrete
5921-17	Bldg. F, Electrical Room	Sheetrock-Joint Compound
5921-18	Bldg. F, Roof, N. Area	Roofing Core
5921-19	Bldg. F, Roof, S. Area	Roofing Core
5921-20	Bldg. F, N. Area, Wall Joint	Mastic
5921-21	Bldg. F, N. Wall	Concrete
5921-22	Bldg. F Floor, Center Area	Concrete
5921-23	Bldg. G Floor, Center Area	Concrete
5921-24	Bldg. N Floor, Center Area	Concrete
5921-25	Bldg. P Floor, Center Area	Concrete
5921-26	Exterior, Center Pillar, N. Area	Stucco
5921-27	Exterior, Center Pillar, Center Area	Stucco
5921-28	Exterior, Center Pillar, S. Area	Stucco

Relinquished by (Client)	Date/Time

Received by (Tech)	Date/Time

Relinquished by (Tech)	Date/Time
<i>Am Wilk</i>	04/02/2024 09:00 AM

Received by (Lab)	Date/Time
<i>mg</i>	04/02/2024 1:40 PM


Sampler: Joseph Wilkins

Total Number of Samples 38

Sample Number:	Location	Description
5921-29	Exterior, P1, N. Wall	Stucco
5921-30	Exterior, P1, S. Wall	Stucco
5921-31	Exterior, P1, E. Wall	Stucco
5921-32	P1, N. Wall	Sheetrock
5921-33	P1 Floor, Center Area	Concrete
5921-34	P3 Floor	Flooring
5921-35	P3, Base	Cove Base Mastic
5921-36	P4 Ceiling	Acoustic Ceiling Tile
5921-37	P4 Floor	Flooring
5921-38	P4 Roof	Roofing Core

Relinquished by (Client)	Date/Time

Received by (Tech)	Date/Time


Relinquished by (Tech)	Date/Time
	04/02/2024 09:00 AM

Received by (Lab)	Date/Time
	04/02/2024 1:40 PM

Sampler: Joseph Wilkins

Total Number of Samples 38



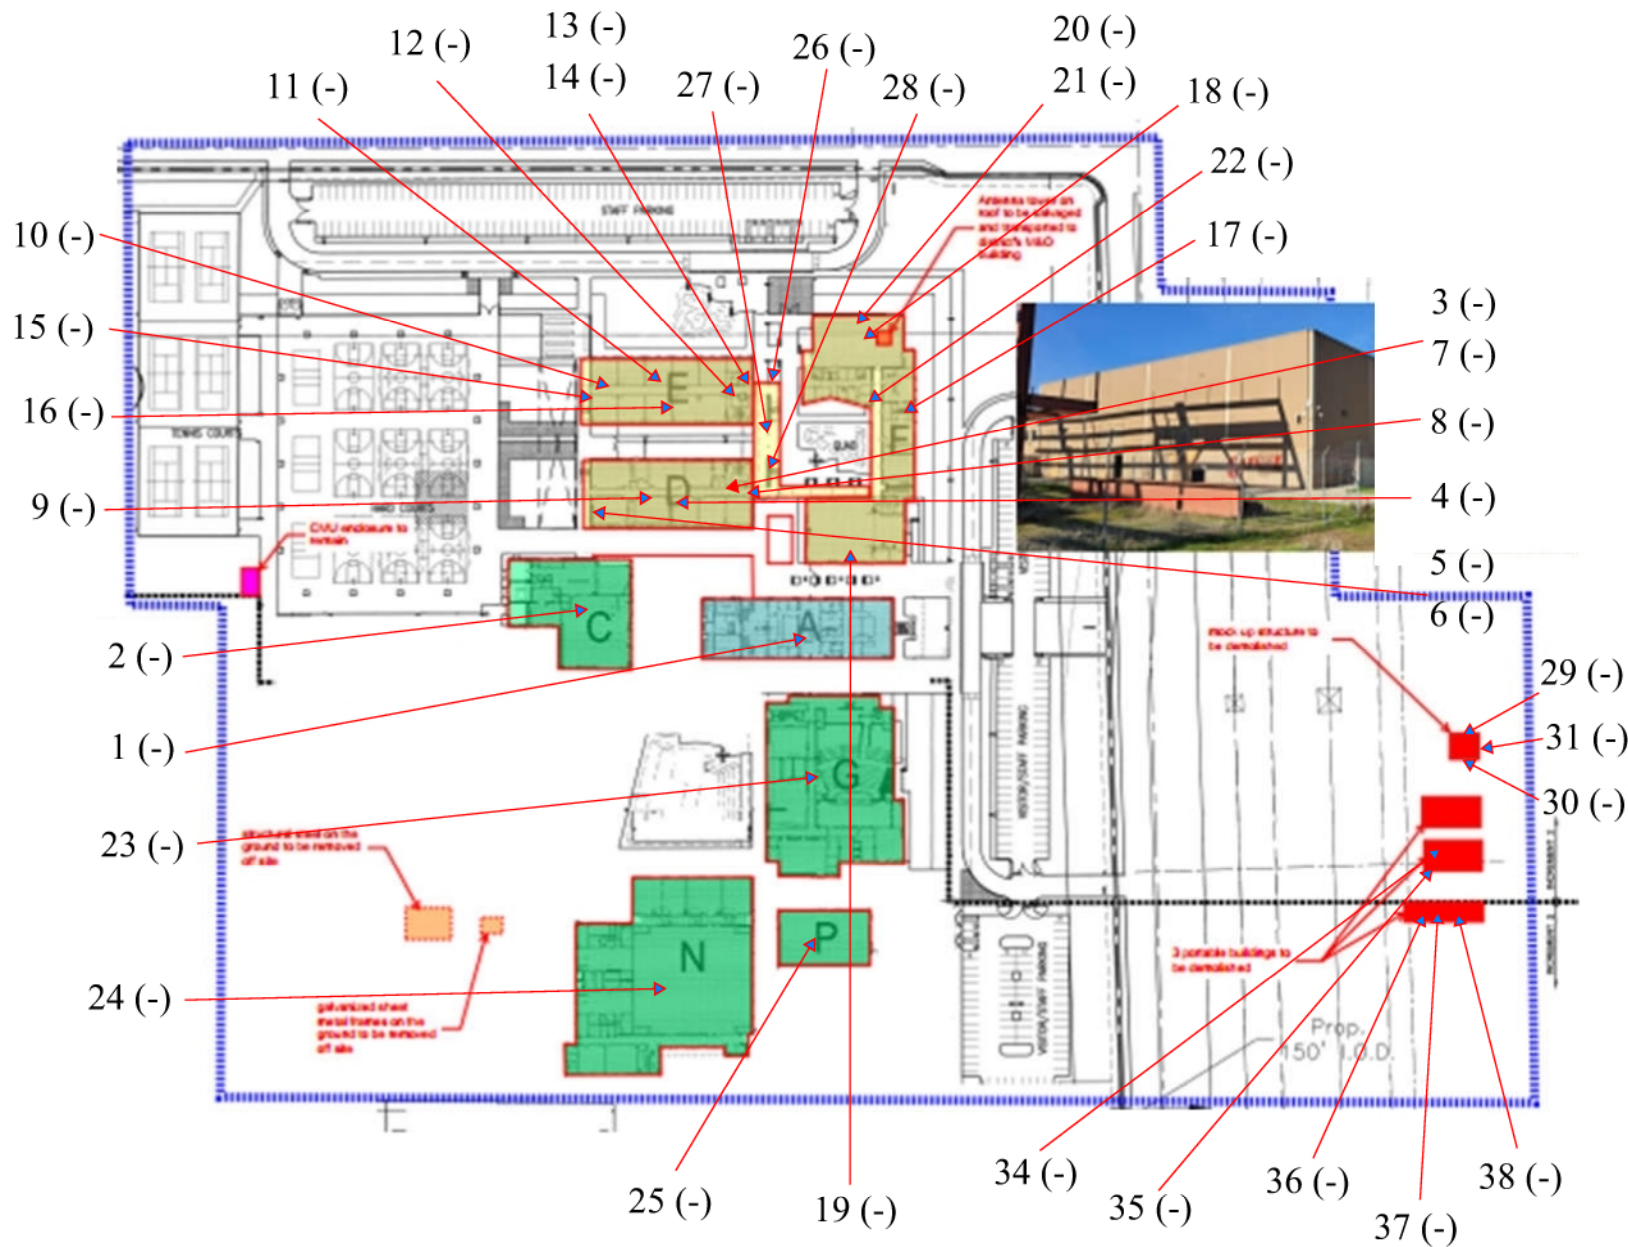

<b>ASBESTOS SAMPLE LOCATION MAP</b>	<b>Site Name:</b> East Natomas Education Complex	<b>Project#:</b> Complex	
<b>Survey Date:</b> 04/02/24	<b>Site Address:</b> 5921 East Levee Road Sacramento, CA 95835	<b>Scale:</b> Not to Scale Layout and Sample Locations Are Approximated.	
<b>Area:</b>		<b>Legend:</b> - Non-Asbestos + Contains Asbestos	